


Instructions for installation

Monolith 15,9 kW

Pro-B2 control unit + power booster

Affixing the sensor to the ceiling:
distance from heater frame 100–300 mm

The temperature sensor should be installed no
less than 1000 mm from an undirected air vent income,
or less than 500 mm from a directed air vent.

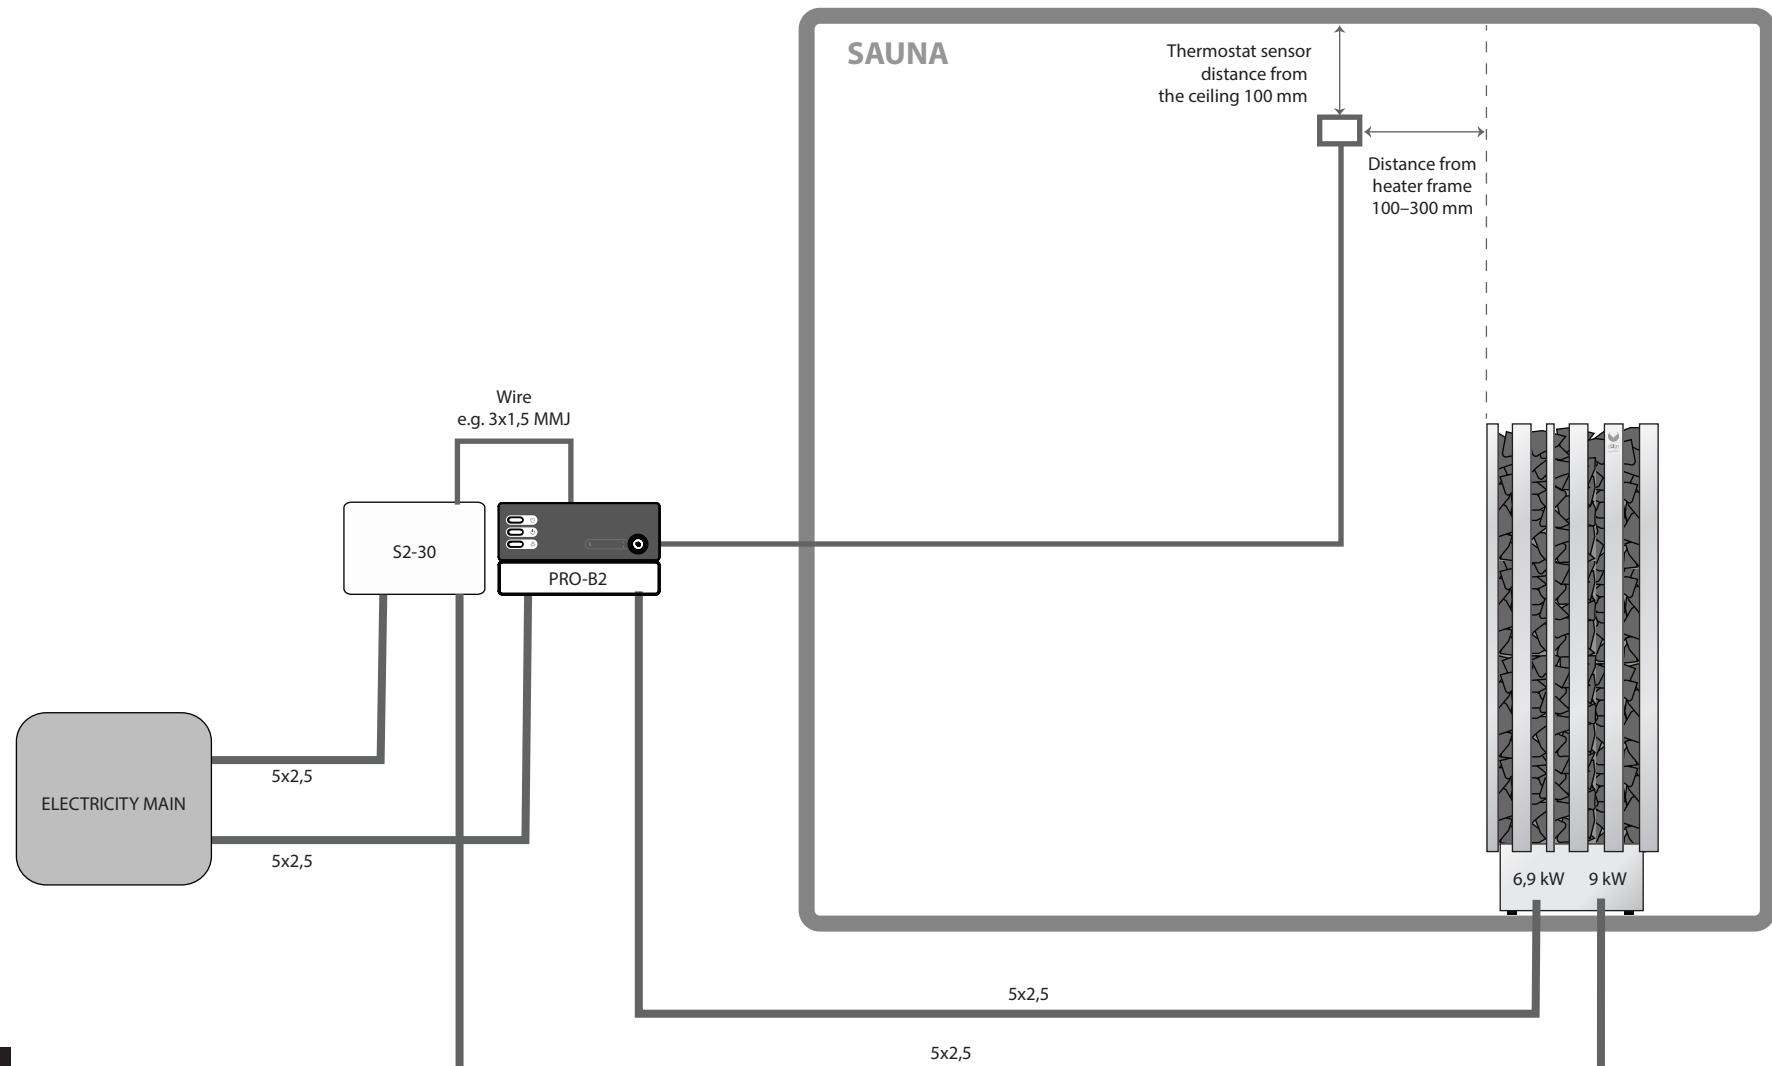

IKI

KIUKAISTA KIUKAIN

© IKI-Kiuas Ltd.